


## Building Inspection Department

County Administration Building  
651 Pine Street, 3rd Floor, North Wing  
Martinez, California 94553-1295  
(925) 646-2300  
Fax: (925) 646-1219

Contra  
Costa  
County



Carlos Baltodano  
Director of Building Inspection

July 9, 2001

David Mendez, Director Model Codes  
Buchanan Airport  
550 Sally Ride Drive  
Concord, CA 94520

Re: Compliance with Prevailing Model Codes, Buchanan Airport East Ramp Hangars,  
Buildings A - E.

Dear Mr. Mendez:

The requested inspections at the above location, occurring on 8 May 2001, 9 May 2001, and 10 May 2001; generated the following list of items that are not in compliance with current codes, the referenced codes are the California Building code, 1998 edition, based on the Uniform Building Code 1997 edition and the California Electrical Code, based on the National Electrical Code 1996 edition; hereafter referred to as the CBC and CEC respectfully.

### A1

1. Protective Globe missing from original overhead light fixture. CEC Articles 410.2, 410.5, 501.9 and 513.
2. Electric-discharge fixture mounted on cabinet within 5' classified zone about aircraft CEC articles 501.9 and 513.2(c).
3. Compressor within 18" classified floor zone CEC articles 501.10 and 513.2.
4. Electrical outlets installed without required permits and inspections CEC articles 90, NFPA 70 and 501.12.

### A2

1. Electric Discharge light fixture suspended within 5' classified zone above Aircraft. CEC articles 501.9 and 513.2 (c).
2. Drop Cord (Power) with Convenience outlet is not approved type. CEC articles 501.11, 501.12 and 513.4 (c).
3. Removal of existing wall at storage area. CBC section 106.
4. Storage of vehicle and non-flight related items. CBC section 311 and CEC article 513.

### A3

1. Electrical outlets installed without required permit and inspection CEC articles 90, NFPA 70 and 501.12.
2. Storage of non-flight related items CBC section 311 and CEC article 513.

### A4

1. Protective globe missing from original overhead light fixture. CEC articles 410.2, 410.5, 501.9 and 513.
2. Electrical lighting and power outlets installed without required permits and inspections, CEC articles 90, NFPA 70, 501.9 and 501.12.
3. Combustible construction of storage loft suspended from steel members of original building. CBC sections 106, 307, and Chapter 6.
4. Lighting within 5' classified zone of Aircraft wing. CEC articles 501-9 and 513.
5. Equipment shall be maintained in good working order, i.e. cracked insulation on compressor connection. CEC articles 110-3 and 501-10.

### A5

1. Protective Globe missing from overhead light fixture. CEC articles 410-2, 410-5, 501-9 and 513.
2. Related storage? CBC section 311 and CEC article 513.

### A6

1. Protective globe missing from original overhead light fixture. CEC articles 410-2, 410-5, 501-9 and 513.
2. Electrical outlets added without required permits and Inspections CEC articles 90, NFPA 70 and 501-12.
3. Storage of vehicle bodies and other non-flight related items. CBC section 311 and CEC article 513.

### A7

1. Protective Globe missing from original overhead light fixture. CEC articles 410-2, 410-5, 501-9 and 513.
2. Electrical outlets added without required permits and Inspections CEC articles 90, NFPA 70 and 501-12.
3. Freestanding work light with GFCI protected outlet within 18" classified floor zone. CEC articles 501-10 and 513 2(b).
4. Air compressor within 18" classified floor zone. CEC articles 501-10 and 513 2(b0).
5. Open electrical connection to plug strip mounted to work bench. CEC articles 110-3, 110-12 and 501-12.
6. Storage of non-flight related items. CBC section 311, and CEC article 513.

#### **A8**

Spotless with no apparent violations.

#### **A10**

No apparent violations.

#### **A11**

1. Electrical outlets installed without required permits and inspections. CEC article 90, NFPA 70 and CEC 501-12.

#### **A12**

1. Electrical lighting and power outlets installed without required permits and inspections, CEC articles 90, NFPA 70, 501-9 and 501-12.
2. Electric discharge fixtures installed within 5' classified zone above aircraft wing. CEC articles 501-9 and 513.
3. Utilization equipment CEC articles 501-10.

#### **A14**

1. Electrical outlet added without required Permit and Inspections. CEC articles 90, NFPA 70 and 501-12.

#### **A15**

1. Protective Globe missing from original overhead light fixture. CEC articles 410-2, 410-5, 501-9 and 513.
2. Electrical outlet (Power Strip) within 5' classified zone of aircraft wing. CEC articles 501-12 and 513-2 (c).
3. Refrigerator within 18" classified floor zone. CEC articles 501-10 and 513-2 (b).
4. Storage of non-flight related items. CBC section 311 and CEC article 513.

#### **A16**

1. Electrical outlet added without permit and inspection. CEC articles 90. NFPA 70 AND 501-12.

#### **C1**

1. Electrical lighting and power outlets installed without required permits and inspections CEC articles 90, NFPA 70 and 501-12.
2. Exposed electrical connection feeding lighting fixtures. CEC articles 110-3, and 501-9, 501-10.
3. Grounding Conductor missing from installation. CEC articles 110, 250, 501 and 513.
4. Non-compliant electrical connection to original overhead light fixture, CEC articles 110, 250, 501 and 513.
5. Loft storage constructed and supported from steel members of original structure. CBC sections 106, 311 and Chapter 6.

## C2

No apparent violations

## C4

1. Electric discharge (High Bay) lighting fixture added in place of original incandescent fixture. CEC articles 90, NFPA 70, 410, 501-9, and 513.
2. Electrical lighting and power outlets installed without required Permits and Inspections. CEC articles 90, NFPA 70, 410, 501-9, and 513.
3. Storage loft constructed and supported from steel members of original building. CBC sections 106, 311, and Chapter 6.
4. Two wheeled cycle and Quad Runner (ATV) stored. CBC section 311 and CEC 513.

## C5

1. Electrical lighting and power outlets installed without required permits and inspections. CEC articles 90, NFPA 70 and 501-12.
2. Electrical outlet and compressor within 18" classified floor zone. CEC articles 501-10 and 501-12, 513 2 (b).
3. Refrigerator within 18" classified floor zone. CEC articles 501-10 and 501-12, 513-2 (b).

## C6

1. Protective globe missing from original overhead light fixture. CEC articles 410-2, 410-5, 501-9 and 513.
2. Added electrical lighting and power outlets without permits and inspections CEC articles 90, NFPA 70 and 513.
3. Cord used in place of permanent wiring methods. CEC article 400-8.
4. Storage sections secured to original structure at perimeter of "T" leg of hangar space. CBC sections 106, 311 and Chapter 6.
5. Soda dispensing machine within 18" classified floor zone. Refrigeration equipment mounted in lower section of machine. CEC articles 501-10 and 513-2.
6. Vehicle storage (non-flight related)

## C7

1. Protective Globe missing from original overhead light fixture. CEC articles 410-2, 410-5, 501-9 and 513.
2. Electrical lighting outlets installed without required permits and inspections, CEC articles 90, NFPA 70, 410-2, 410-5, 501-9, 501-11 and 513.
3. Electrically operated floor lift within 18" classified zone. CEC articles 501-10, 513-11.
4. Non-flight related "Jet Ski's" stored (pun not intended).

#### **C8**

1. Protective Globe missing from original overhead light fixture. CEC articles 410-2, 410-5, 501-9 and 513.
2. Electrical lighting and power outlets added without required permits and inspections. CEC articles 90, NFPA 70 and 501-12.
3. Portable carpet vacuum in violation if used within the classified area about and aircraft and within hangar. CEC articles 501-10 and 513.
4. Storage of non-flight related items.
5. Refrigerator within 18" classified floor zone CEC 501-10 and 513-2 (b).

#### **C9**

1. Protective globe missing from original overhead lighting fixture. CEC articles 410-2, 410-5, and 501-9.
2. Electrical lighting and power outlets installed without required permits and inspections. CEC article 90, NFPA 70, and 501-9.
3. Cord used in place of permanent wiring methods. CEC article 400-8.
4. Electric discharge lighting installed within classified zone above aircraft. (Above nose and leading edge of wings). CEC articles 501-9 and 513-2 (c).
5. Compressor within 18" classified floor zone. CEC articles 501-10 and 513-2 (b).
6. Non-flight related storage.

#### **C10**

1. Electrical lighting installed without required permits and inspections. CEC articles 90, NFPA 70, 410-2, 410-5, 501-9 and 513.
2. Cord used in place of permanent wiring methods. CEC article 400-8.
3. Storage loft added without required approvals of material and method. CBC sections 106, 311 and Chapter 6.

#### **C11**

No apparent violations.

#### **C13**

1. Added electrical lighting and power outlets without required permits and inspections. CEC articles 90, NFPA 70, 410-2, 410-5, 501-9 AND 513.
2. Lighting fixtures in classified zone above aircraft are not of approved type. CEC 410-2, 410-5, 501-9 and 513.
3. Storage loft installed without required approvals of materials and methods, in addition to required permit. CBC sections 106, 311 and Chapter 6.
4. Cord used in place of permanent wiring methods. CEC article 400-8.
5. Exposed electrical conductor and light fixture lacking grounding conductor. CEC articles 110, 250, 501-6, and 513.

#### **C15**

No apparent violations

#### **C16**

1. Protective globe missing from original overhead light fixture. CEC articles 410-2, 410-5, 501-9 and 513.
2. Stored vehicle.

#### **C17**

1. Electrical outlet added without required permit and inspection. CEC article 106, 501-12, and 513.

#### **C18**

1. Electrical lighting and power outlets installed without required permits and inspections, CEC articles 90, NFPA 70, 410-2, 410-5, 501-9, 501-10, 501-12 and 513.
2. Storage loft suspended from steel members of original structure. CBC sections 106, 311 and Chapter 6.
3. Refrigerator within 18" classified floor zone. CEC articles 501-10 and 513 2 (b).

#### **D1**

1. Electrical lighting installed, cord is used from original overhead light fixture as power source. CEC articles 90, NFPA 70, 400-8.
2. Lighting fixture above aircraft not of enclosed type. CEC 501-9 and 513.
3. Vehicle (97 registration) and other non-flight related storage.
4. Compressor and refrigerator within 18" classified floor zone, CEC 501-10, and 513-2 (b).
5. Storage loft supported from original steel structure. CBC 106, 311 and Chapter 6.

#### **D2**

1. Fan connection within 18" classified floor zone CEC 501-12 and 513-2 (b).
2. Non-flight related storage.

#### **D3**

1. Electrical lighting and power outlets installed without required permits and inspections. CEC articles 90, NFPA 70, 410-2, 410-5, 501-9, 501-12 and 513.
2. Storage loft constructed and supported from steel members of original structure. CBC sections 106, 311 and Chapter 6.
3. Refrigerator within 18" classified floor zone. CEC 501-10, 501-12, and 513-2 (b).

#### **D4**

1. Electrical lighting and power outlets added without required permits and inspections. CEC articles 90, NFPA 70, 410-2, 410-5, 501-9, 501-12 and 513.

#### **D5**

1. Electrical lighting and power outlets added without required permits and inspections. CEC articles 90, NFPA 70, 410-2, 410-5, 501-9, 501-12 and 513.
2. Cord used in place of permanent wiring methods. CEC article 400-8.

3. Lighting fixtures above aircraft not approved for use or location. CEC 501-9 and 513.
4. Freestanding work/trouble light fixture with power outlet within 18" classified floor zone. CEC 501-12 and 513.
5. Storage lofts added supported from steel members of original structure CBC sections 106, 311 and Chapter 6.

#### **D6**

1. Electrical lighting and power outlets added without required permits and inspections. CEC article 90, NFPA 70, 501-9, 501-12, 410-2, 410-5 and 513.

#### **D7**

1. Electrical lighting and power outlets added without required permits and inspections, CEC articles 90, NFPA 70, 410-2, 410-5, 501-9, 501-12 AND 513.
2. Cord fed lighting above aircraft in classified zone not approved type for location and use. CEC 90, NFPA 70, 410-2, 410-5, 501-9, and 513.
3. Electric portable fan and refrigerator within classified floor zone CEC articles – 501-10, and 513-2 (b).
4. Storage loft added supported from steel members of original structure. CBC sections 106, 311 and Chapter 6.
5. Storage of non-flight related items, i.e. "Harmon SO2 Generator" and landscape type low trailer.

#### **D8**

1. Electrical lighting and power outlets added without required permits and inspections. CEC articles 90, NFPA 70, 410-2, 410-5, 501-9 501-12 and 513.
2. Open incandescent light fixtures above aircraft. CEC articles 90, NFPA 70, 410-2, 410-5, 501-9 and 513.
3. Storage of non-flight related items, i.e. vehicle, ski-boat and flat bottom "John" boat.

#### **D9**

1. Protective globe missing from original overhead light fixture. CEC articles 410-2, 410-5, 501-9 and 513.

#### **D10**

1. Electrical lighting and power outlets added without required permits and inspections. CEC article 90, NFPA 70, 410-2, 410-5, 501-9, 501-12 and 513.
2. Lighting above aircraft in classified zone not approved for location or use. CEC articles 501-9 and 513.
3. Refrigerator within 18" classified floor zone CEC articles 501-10, 501-12 and 513-2 (b).
4. Storage of non-flight related items.

#### **D11**

1. Protective globe missing from original overhead light fixture. CEC articles 410-2, 410-5, 501-9 and 513.
2. Electrical lighting and power outlets added without required permits and inspections. CEC articles, 90, NFPA 70, 410-2, 410-5, 501-9, 501-12 and 513.

#### **D12**

1. Protective globe missing from original overhead light fixture. CEC articles 410-2, 410-5, 501-9 and 513.
2. Electrical power outlet added. CEC articles 90, NFPA 70, 501-12 AND 513.

#### **D13**

1. Protective globe missing from original overhead light fixture. CEC articles 410-2, 410-5, 501-9 and 513.
2. Storage loft with lighting installed without required permits and inspections. CBC sections 106, 311 and Chapter 6, CEC articles 90, NFPA 70, 410-2, 410-5, 501-9 and 513.
3. Refrigerator within classified floor zone. CEC articles 501-10 and 513-2 (b).

#### **D14**

1. Small capacity compressor within 18" classified floor zone, CEC articles 501-10 and 513-2(b).

#### **D15**

1. Protective globe missing from original light fixture. CEC articles 410-2, 410-5, 501-9 and 513.
2. Storage of non-flight related item. (Vintage Porsche).
3. Open electrical Junction Box. CEC article 370-25.

#### **D16**

No apparent violations

#### **D17**

1. Electrical lighting and power outlets to include ceiling fans installed without required permits and inspections CEC articles 90, NFPA 70, 410-5, 410-2, 422, 501-9 and 513.
2. Lighting fixtures in classified zone above aircraft not approved for location. CEC articles 501-9 and 513.
3. Storage loft installed partially supported from steel members of original structure. CBC 106, 311 and Chapter 6.
4. Refrigerator within the 18" classified floor zone. CEC 501-10 and 513.



#### **D18**

1. Electrical lighting and power outlets added without required permits and inspections. CEC articles 90, NFPA 70, 410-2, 410-5, 501-9, 501-12 and 513.
2. Lighting fixtures in classified zone above aircraft not approved for location. CEC articles 501-9 and 513.
3. Knockouts in fixtures shall be sealed CEC 370-18 and 410.

#### **D19**

1. Electrical power outlets added without required permit and inspection. CEC articles 90, NFPA 70, 110, 300, 410, 501-12 and 513.

#### **D20**

1. Protective globe missing from original overhead light fixture. CEC articles 410-2, 410-5, 501-9 and 513.
2. Electrical power outlets added without required permit and inspection. CEC articles 90, NFPA 70, 110, 300, 410, 501-12 and 513.
3. Storage of non-flight related items.

#### **D West Pilots**

1. Support conduit as per code. CEC articles 110, 300 and 348.

#### **D East**

1. Electrical lighting and power outlets installed (added) without required permits and inspections. CEC articles 90, NFPA 70, 410, 501, and 513.
2. Extensive metal framing used to construct storage areas without permits and inspection. CBC 106, 311 and Chapter 6.
3. Hangar space being used for other than aircraft storage. (Vehicle Restoration etc.)

#### **E1**

1. Electrical power outlet added without permit and inspection. CEC articles 90, NFPA 70, 410, 501 and 513.
2. Refrigerator within 18" classified floor zone. CEC articles 501-10 and 513.

#### **E3**

1. Electrical power and lighting outlets added without required permits and inspections. CEC 90, NFPA 70, 410-2, 410-2, 410-5, 501-9 and 513.
2. Lighting fixtures above aircraft are not approved for use. CEC 410-2, 410-5, 501-9 and 513.
3. Storage loft and stair access installed without required permits and inspections. UBC 106, Chapter 6 and 1003.3.3.
4. Refrigerator within 18" classified (no fly) zone. CEC articles 501-10 and 513.

#### **E4**

1. Electrical conduit system installed, CEC 90, NFPA 70, 348 and 410.
2. Storage non-flight related item. (Vehicle)

#### **E5**

1. Electrical lighting and power outlets added without required permits and inspections CEC 90, NFPA 70, 410, 501 and 513.

#### **E6**

1. Storage loft installed supported from original building steel members. CBC 106, 311, and Chapter 6.
2. Electrical light fixtures above aircraft are not of approved type for location. CEC 90, NFPA 70, 410, 501, and 513.
3. Flexible metal conduit installed at perimeter of hangar space. CEC article 90, NFPA 70, 350, 501 and 513.

#### **E7**

1. Electrical power outlet installed without required permit and inspection. CEC 90, NFPA 70, 110, 300, 501 and 513.

#### **E8**

#### **SPOTLESS**

#### **E9**

1. Storage shelves supported/secured to original steel structure. CBC 106, 311 and Chapter 6.
2. Electrical power outlet installed without required permit and inspection. CEC 90, NFPA 70, 110, 300, 501 and 513.

#### **E10**

1. Lighting and power outlets installed without required permits and inspections. CEC 90, NFPA 70, 110, 300, 501 and 513.
2. Fixtures (lighting) lack grounding/bonding conductor. CEC 250, 410, 501 and 513.
3. Lighting fixtures installed above aircraft are not approved for location. CEC 410, 501 and 513.

#### **E11**

1. Electrical lighting and power outlets added without required permits and inspections. CEC 90, NFPA 70, 410-2, 410-5, 501-9 and 513.
2. Electrical lighting fixtures installed above aircraft are not approved for use. CEC articles 410, 501, and 513.
3. Storage loft installed supported from steel members of original structure. CBC sections 106, 311 and Chapter 6.

### **E12**

1. Electrical power outlet added without permit and inspection. CEC 90, NFPA 70, 410, 501 and 513.
2. Original overhead light fixture replaced with electric discharge "Hy-Bay" fixture CEC 90, NFPA 70, 410, 501 and 513.
3. Shelves 8'-10' in height in addition to fair amount of non-flight related items. CBC 106,

### **E13**

1. Electrical lighting and power outlets added without required permits and inspections. CEC 90, NFPA 70, 410, 501 and 513.
2. Storage loft supported by original structure. CBC 106, 311 and Chapter 6.
3. Lighting fixtures above aircraft are not approved for location. CEC articles 410, 501, and 513.
4. Metal clad cable not installed as per code. CEC articles 100, 300 and 334.

### **E14**

1. Electrical lighting and power outlets added without required permits and inspections. CEC 90, NFPA 70, 100, 300, 410, 422, 501 and 513.
2. Lighting fixtures above aircraft are not approved for location. CEC articles 410, 501 and 513.
3. Storage added at perimeter of T leg area of hangar. CBC 106, 311 and Chapter 6.
4. Storage of non-flight related items.

### **E15**

1. Electrical lighting and power outlets added without required permits and inspections. CEC articles 90, NFPA 70, 110, 300, 410, 422, 501 and 513.
2. 4' x 8' shelves supported from steel members of original structure. CBC 106, 311 and Chapter 6.

### **E16**

1. Electrical lighting and power outlets added without required permits and inspections. CEC article 90, NFPA 70, 110, 300, 410, 501, and 513.
2. Storage lofts added structure supported. CBC 106, 311 and Chapter 6.

### **E17**

1. Electrical lighting and power outlets added without required permits and inspections. CEC articles 90, NFPA 70, 110, 300, 410, 501 and 513.
2. Removal of original overhead light fixture. CEC article 90, NFPA 70.
3. Light fixtures not approved for location CEC articles 410, 501, and 513.
4. Refrigerator within 18" classified floor zone, CEC articles 501-10 and 513.
5. Storage shelves installed supported from steel members of original structure.

**E19**

1. Electrical lighting and power outlets added without required permits and inspections. CEC articles 90, NFPA 70, 110, 300, 410, 501 and 513.
2. Electrical lighting above aircraft is not of approved type for location. CEC 410, 501 and 513.
3. Storage shelves installed supported from steel members of original structure, CBC 106, 311, and Chapter 6.
4. Vintage Vehicle stored.

**E20**

1. Electrical power outlets without required permit and inspections. CEC 90, NFPA 70, 110, 300, 501 AND 513.
2. Electrical outlet box lacking cover, CEC 110, 300, 370.
3. Storage shelf with cord fed lighting, CBC 106, 311 and Chapter 6, CEC 400.

**E21**


1. Electrical lighting and power outlets added without the required permits and inspections. CEC 90, NFPA 70, 110, 300, 410, 501 and 513.
2. Lighting fixtures above aircraft are not approved for location. CEC 410, 501, and 513.
3. Electrical connections open and unprotected in overhead area of hangar space. CEC 110, 300.
4. Non-flight related storage.
5. Combustible material creating 8' partition with overhead storage. CBC 106, 311 and Chapter 6.

**E. East**

1. Separation wall removed. CBC 106 does not appear to be additional violations.

If you have any question please call this office or contact me at (925) 335-1157.

Sincerely,

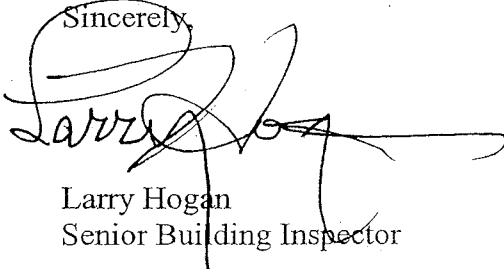A handwritten signature in black ink, appearing to read "Larry Hogan", with a long horizontal flourish extending to the right.

Larry Hogan  
Senior Building Inspector

LH/mb

S:/clerksbi/Compliance Buchanan Airport

Cc: Steven K. April, Fire Inspector, Code Enforcement Division

# Building Inspection Department

County Administration Building  
651 Pine Street, 3rd Floor, North Wing  
Martinez, California 94553-1295  
(925) 646-2300  
Fax: (925) 646-1219

# Contra Costa County



**Carlos Baltodano**  
Director of Building Inspection

RECEIVED  
BUCHANAN  
AIRPORT

2001 AUG -2 A 9:43

August 1, 2001

David Mendez, Director of Airports  
Buchanan Airport  
550 Sally Ride Drive  
Concord, CA 94520

RE: Compliance with prevailing model codes.  
Buchanan Airport remaining east  
Ramp Hangars  
Building A, C and E

Dear Mr. Mendez,

An inspection of the remaining hangars was conducted on July 20, 2001. The included list of code violations is the result of that inspection.

**A9:**

- 1) Electric discharge fixtures above aircraft are not approved for use/location. CEC 501-9 and 513.
- 2) Gasoline and electric motors within 18" classified floor zone. CEC 501-10, 501-12 and 513 2(b).
- 3) Electrical system altered without permits and inspections. CEC Articles 90 (NFPA 70), 410-2, 410-5, 501-9, 501-12 and 513.
- 4) Cord used in place of permanent wiring methods. CEC 400-8.
- 5) Portable power strips within classified areas. CEC 500, 513.
- 6) Storage of non-flight related items.

**A13:**

- 1) Electrical power and lighting added without required permits and inspections. CEC articles 90 (NFPA 70), 410-2, 410-5, 501-9, 501-12 and 513.
- 2) Electric discharge fixtures not approved for use in classified areas. CEC 501-9 and 513.
- 3) Storage loft partially supported from original steel structure. CBC 106, 311, Chapter 6 and 2316.
- 4) Storage of non-flight related items.

C3:

- 1) Protective globe missing from original overhead light fixture. CEC Articles 410-2, 410-5, 501-9 and 513.
- 2) Cord used in place of permanent wiring methods. CEC 400-8.
- 3) Storage loft suspended from original steel structure. CBC 106, 311, Chapter 6 and 2316.
- 4) Storage of non-flight related items.

C12:


- 1) Storage of non-flight related items.

E2:

- 1) Electric discharge fixtures above aircraft are not approved for use/location. CEC 501-9.
- 2) Electrical lighting and power outlets installed without required permits and inspections. CEC Article 90 (NFPA 70), 410-2, 410-5, 501-9, 501-12 and 513.
- 3) Storage loft used for non-flight related items. CBC 106, 311, Chapter 6 and 2316.
- 4) Refrigerator within 18" classified floor zone. CEC 501-10, 501-12 and 513 2(b).
- 5) Cord used in place of permanent wiring methods CEC 400-8.
- 6) Gasoline aircraft mover within 18" classified floor zone. CEC 501-10, 501-12 and 513 2(b).

If you have any questions please feel free to call me at (925) 335-1157.

Sincerely,

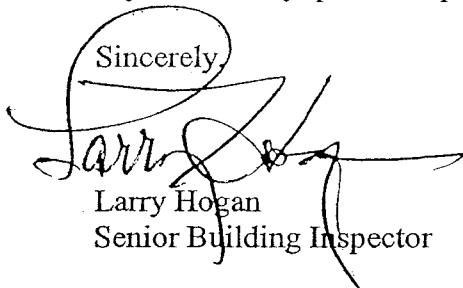

Larry Hogan  
Senior Building Inspector

LH:bsp

S:/clerks-bi/planchecorrection/buchanan